

Installation Instructions

RCK-1 Roof Cable Clips


For Self-Regulating CPR Heating Cables



PJ481-4
161-511930-005
May 2020

RDK-1 Downspout Hanger Kit

Self-Regulating CPR Heating Cable Installation Instructions

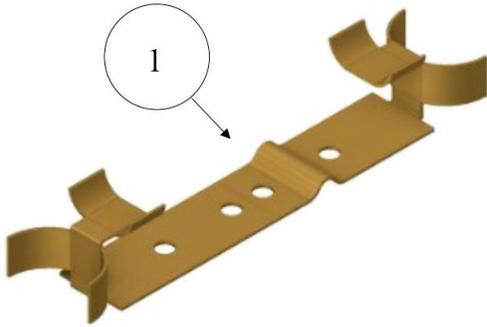

| Item | Qty | Description |
|------|-----|-----------------|
| 1 | 5 | Roof Cable Clip |


General

The RCK-1 Roof Cable Clip is used to attach Chromalox heating Cable to most types of roof surfaces. This kit contains five (5) double slips, which is enough for approximately seven linear feet of roof edge.


Certifications & Approvals



Tools Required for Kit Installation

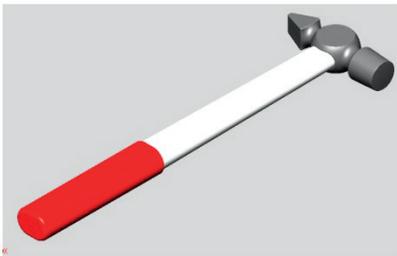

Actual Kit Dimensions

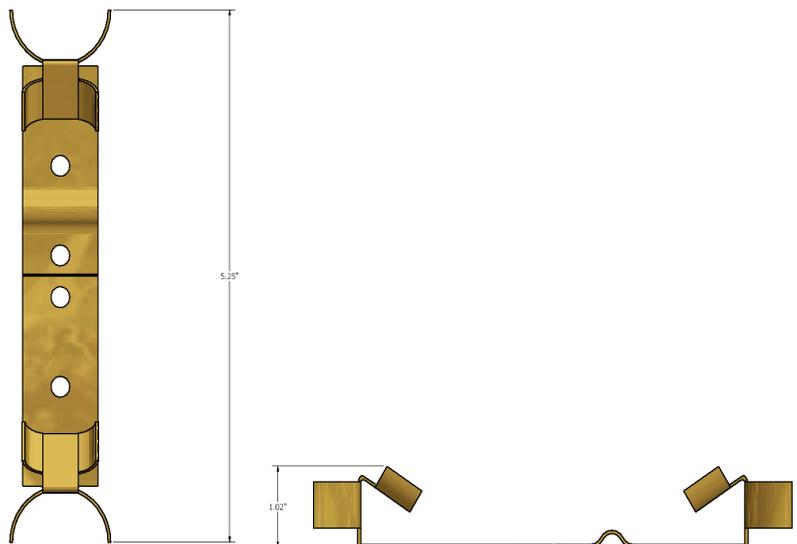

⚠ WARNING

HAZARD OF ELECTRIC SHOCK. Disconnect all power before starting. All installations must be effectively grounded in accordance with the National Electrical Code to eliminate shock hazard.



⚠ WARNING

Turn off power before removing junction box cover at all times.



⚠ WARNING

Users should install adequate controls and safety devices with their electric heating equipment. Where the consequences of failure may be severe, back-up controls are essential. Although the safety of the installation is responsibility of the user, Chromalox will be glad to assist in making equipment recommendations.

RCK-1 Installation Instructions

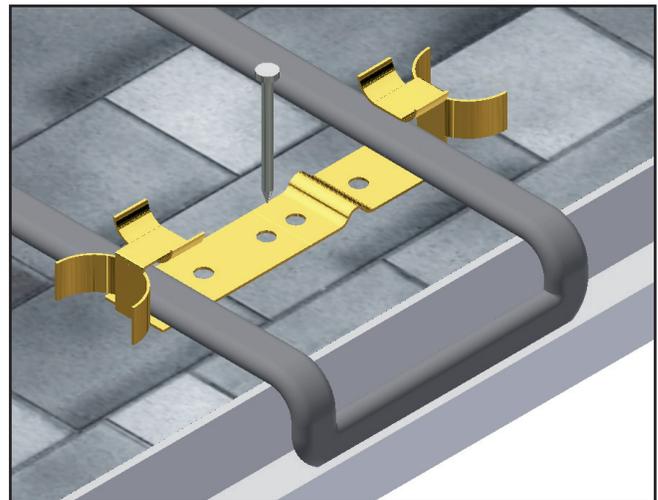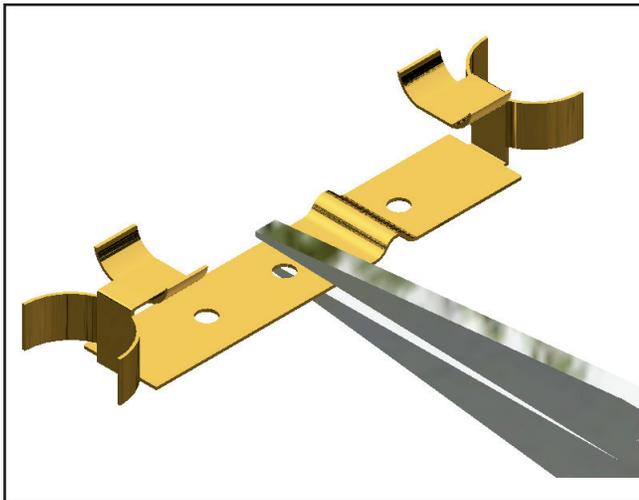

1. Plan the layout of the roof clips according to the installation instructions supplied with the cable. One double clip is used to secure the hearing cable looped at the roof edge (this assures a drainage channel to the gutter). A single clip is used to fasten the cable at the tip of the saw tooth layout arrangement Single clips are made by snapping the double clip in two at the scored indentation.
2. Fasten the clips to the roof with roofing nails or screws. Apply water sealing material around the nail/screw to prevent water leakage.

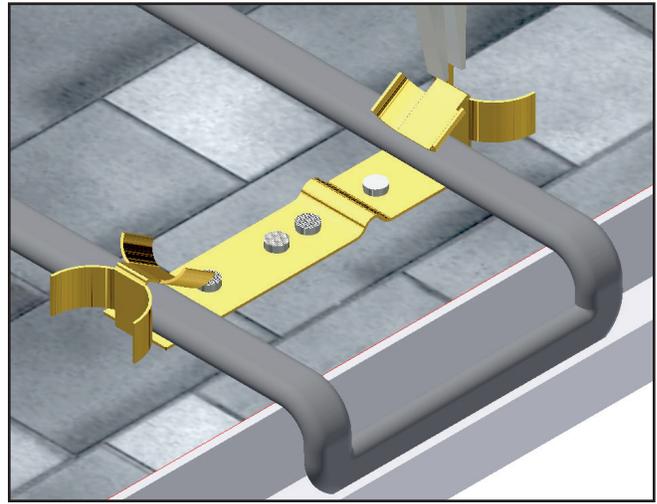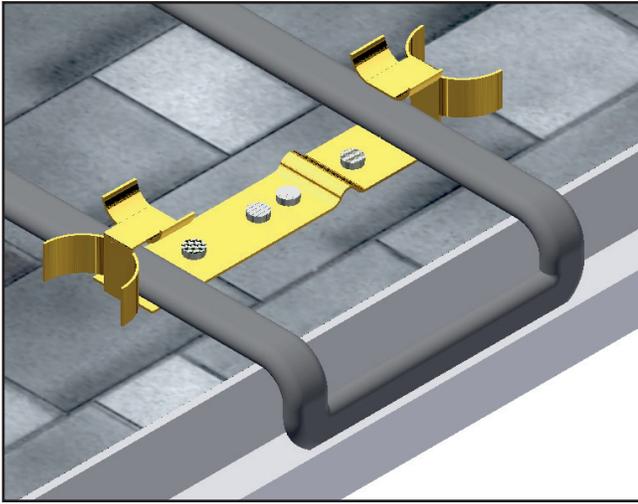

3. After installing the clips on the roof, thread the heating cable around the clips. Used extra clips in any location where the heating cable is susceptible to excess stress or movement.

4. Using pliers, close the clips firmly around the cable, being careful not to crush the cable.

Limited Warranty:

Please refer to the Chromalox limited warranty applicable to this product at <http://www.chromalox.com/customer-service/policies/termsofsale.aspx>.

Chromalox, Inc.
1347 Heil Quaker Boulevard
Lavergne, TN 37086
(615) 793-3900
www.chromalox.com